

	Observed (seconds)	Expected (seconds)
On-peak period	0	55.2
Mid-peak period	0	41.4
Off-peak period	0	69.1

Table 5: Comparison of loss durations observed in numerical simulation and expected from the teletraffic theory.

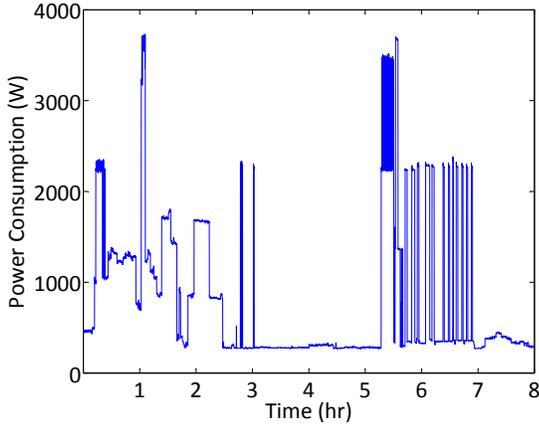


Figure 6: On-peak load measured from a house in class 1

This is done simply by summing the actual measured load from each home at each time instant and checking if this sum exceeds the transformer sizing. If our models are representative, then the probability of overflow computed using teletraffic theory should be an upper bound on the numerical estimate. Table 5 shows the results, indicating that our reference models are representative, at least for the purpose of transformer sizing in the electrical grid. This result, though positive, does not give a good ‘feel’ for our models. A less analytical, but still useful, validation is by visual inspection. Figure 6 shows actual measurements of on-peak loads of a home in class 1 obtained from the test data set. We see that it is similar to the on-peak home load generated from the on-peak model of class 1 (Figure 7). This was true for all of our other models as well.

7. CONCLUSION

This paper reports very encouraging preliminary results on load modelling. Using an existing classification, we derive per class k -state Markovian reference models for different periods of the day. We show that none of these models need more than 6 states. We also show that these models are accurate enough for transformer sizing in the distribution network.

8. REFERENCES

- [1] Current cost. <http://www.currentcost.com/>, January 2011.
- [2] O. Ardakanian. Resource provisioning in the electrical grid. Thesis, University of Waterloo, 2011.

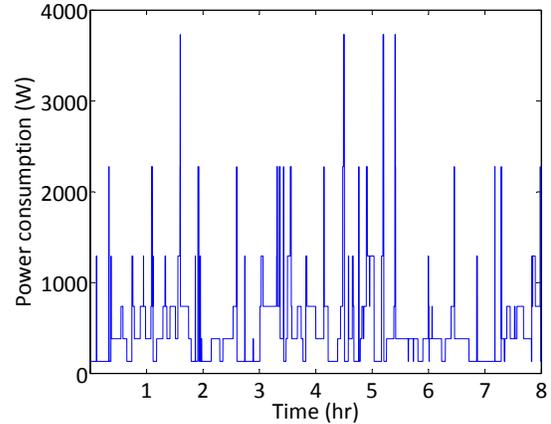


Figure 7: On-peak load trace generated from the on-peak model of class 1

- [3] M. Armstrong, M. Swinton, H. Ribberink, I. Beausoleil-Morrison, and J. Millette. Synthetically derived profiles for representing occupant-driven electric loads in Canadian Housing. *J. of Building Performance Simulation*, 2(1):15–30, 2010.
- [4] A. Capasso, W. Grattieri, R. Lamedica, and A. Prudenzi. A bottom-up approach to residential load modeling. *IEEE Trans. Power Systems*, 9(2):957–964, 2002.
- [5] W. Cochran. *Sampling techniques*. John Wiley & Sons Inc, 1977.
- [6] R. Durbin, S. Eddy, A. Krogh, and G. Mitchison. *Biological Sequence Analysis*. Press, Cambridge U., 11 edition, 2006.
- [7] A. Elwalid, D. Heyman, T. V. Lakshman, D. Mitra, and A. Weiss. Fundamental bounds and approximations for ATM multiplexers with applications to video teleconferencing. *IEEE JSAC*, 13(6):1004–1016, 1995.
- [8] C. D. Manning and H. Schuetze. *Foundations of Statistical Natural Language Processing*. The MIT Press, 1 edition, 1999.
- [9] J. Paatero and P. Lund. A model for generating household electricity load profiles. *International J. of Energy Research*, 30(5):273–290, 2006.
- [10] L. Rabiner and B. Juang. An introduction to hidden markov models. *ASSP Magazine, IEEE*, 3(1):4 – 16, jan 1986.
- [11] I. Richardson, M. Thomson, D. Infield, and C. Clifford. Domestic electricity use: A high-resolution energy demand model. *Energy and Buildings*, 2010.
- [12] J. W. Roberts. Performance evaluation and design of multiservice networks. COST 224 Final Report, Commission of the European Communities, October 1992.
- [13] P. Sen, B. Maglaris, N.-E. Rikli, and D. Anastassiou. Models for packet switching of variable-bit-rate video sources. *Selected Areas in Communications, IEEE Journal on*, 7(5):865 –869, June 1989.